
### **SIEMENS**

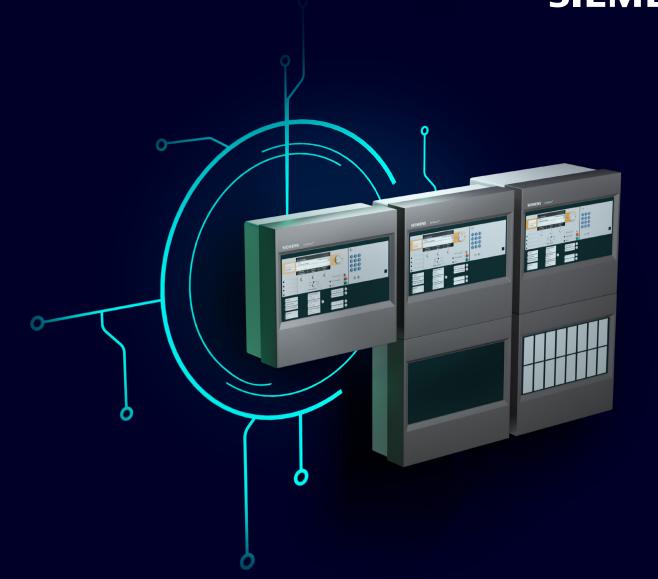

#### © Siemens Switzerland Ltd, 2024 are binding only when they are expressly agreed upon in the concluded contract. course of further development of the products. The requested performance features specifically reflect those described, or which may undergo modification in the contains general descriptions and/or performance features which may not always Subject to changes and errors. The information given in this document only

761 +41 58 724 24 24 Switzerland გი<u>Z</u> 00£9 Theilerstrasse 1a International Headquarters Building Technologies Division 5iemens Switzerland Ltd 2024 Published by

Article no. BT\_0149\_EN (Status 10/2024)

#### siemens.com/smart-infrastructure Creating environments that care.


and supports sustainable development. It helps our customers to thrive, communities to progress

people and helps customers to better use resources. ecosystem that intuitively responds to the needs of We work together with customers and partners to create an

buildings and industries to adapt and evolve the way we live Smart Infrastructure intelligently connects energy systems,

### **Cerberus PRO – Because smarter protection matters**


IoT-enabled fire control panels, clever fire detectors, smart peripheral devices: Our products & solutions allow you to protect your building and its occupants all year-round, connect with it anytime from anywhere via the Building X Fire Apps, and sustain undisturbed places all day, every day for peace of mind. The overview below demonstrated the most important components.

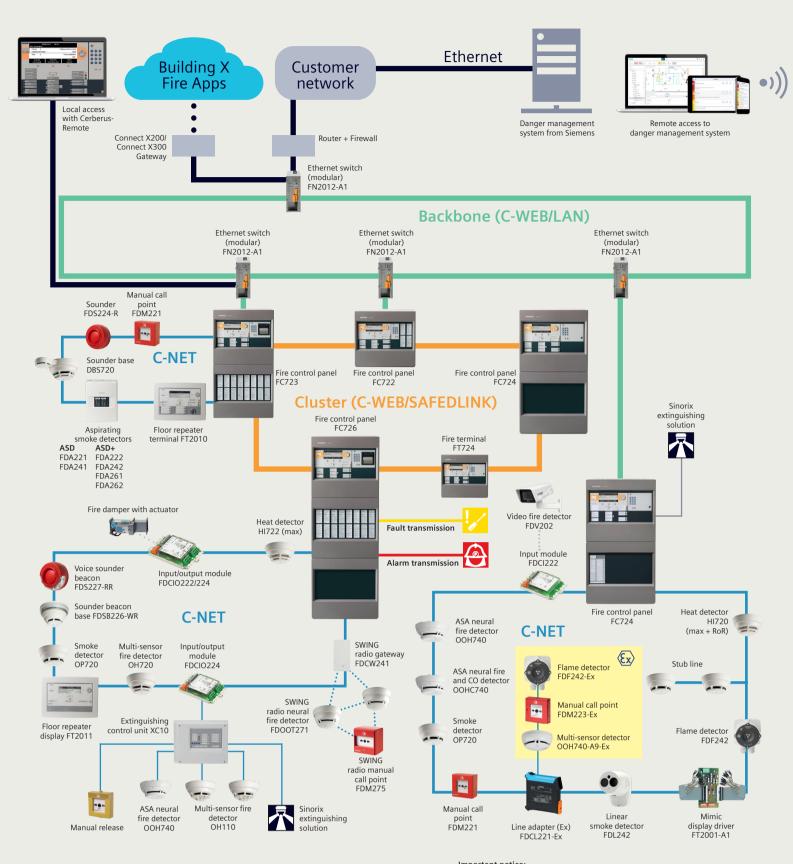

Simplified drawing without additional network hardware and safety components. Allowed configurations are described in the document "Network Security Guidelines", Doc. ID A6V101039439. Contact your Siemens IT Security expert for details.


### **Topology 1**

Up to 16 panels can be networked in a cluster (C-WEB/SAFEDLINK) – if connected to a danger management system. Without a danger management system, even up to 32 panels can be networked.

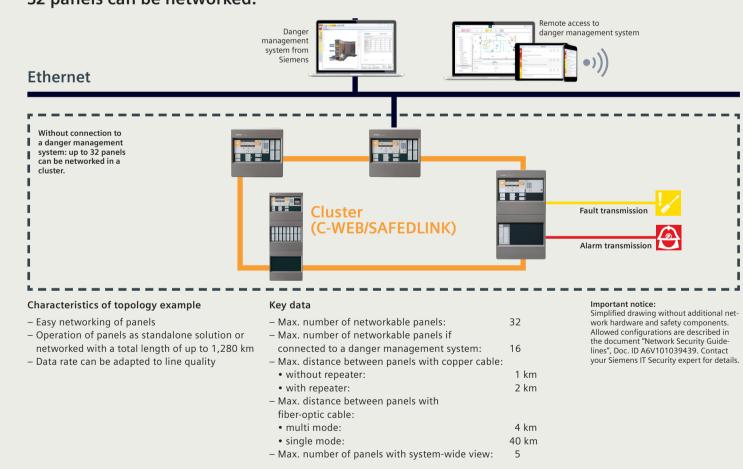

### **Topology 2**

Up to 64 panels in one EN 54-compliant system using a backbone (C-WEB/LAN) without

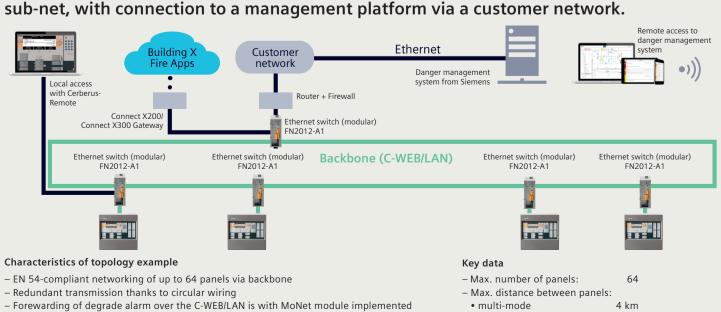

single mode

#### - Optional danger management system Remote access with Building X Fire Apps – Better performance on BACnet communication from stations to Management platform

- Increased EMC protection thanks to fiber-optic cabling

- Common remote transmission to the fire brigade

Configurable view of each panel

### Panel overview compact

Power supply		FC721-ZZ/-YZ	FC722-ZZ/-YZ	FC722-ZA/-ZE	FC724-ZA/-ZE	FT724-ZZ
Mains voltage						
Power supply		Housing Eco	Housing Standard	Housing Comfort	Housing Comfort	Housing Eco
Operating voltage         DC 2128.6 V         DC 2128.6 V         DC 2128.4 V         DC 2	Mains voltage					-
Departing current	Power supply	70 W	70 W	150 W	150 W	option PSU 70 W
Battery capacity	Operating voltage	DC 21 28.6 V	DC 2128.6 V	DC 2128.4 V	DC 2128.4 V	DC 2128.4 V
Emergency power supply   Up to 72 h   Up t	Operating current	max. 2.5 A	max. 2.5 A	max. 5 A	max. 5 A	125 mA
Cerberus PRO FD720   Cerberu	Battery capacity	2x 12 V, 7 Ah	2x 12 V, 712 Ah	2x 12 V, 26 Ah	2x 12 V, 26 Ah	option 2x 12 V, 7 Ah
Number of lines	Emergency power supply	up to 72 h <sup>1)</sup>	up to 72 h <sup>1)</sup>	up to 72 h	up to 72 h	up to 72 h
With loop extension   Stub lines   Stub l						-
Networkable	<ul><li>C-NET integrated (with loop extension)</li></ul>					-
Networkable	Number of addresses	max.126	max. 252	max. 252	max. 504	_
Integrated inputs/outputs - Relay outputs - RT fault - RT fault - RT fault - Monitored outputs - Alarm - Fault - Fault - Horn -	Networkable	_	<b>✓</b>			<b>✓</b>
Display groups integrated, each with one red, green and yellow LED  Display groups optional, each with one red, green and yellow LED  Up to 96³¹/-  up to 96³³/-  up to 96³³/-  up to 96¹³/-  up to 96¹³/-  Plug-in position for RS232, RS485 serial ports  1  2  2  2  2  2  Ethernet connection RJ45  1  1  1  1  1  1  1  Dimensions (WxHxD)  Approvals  - CPR - CPR - VdS  - WS6-CPR-20767 - G209076  - G209076  - G209076  - CPR - CP	<ul> <li>Relay outputs</li> <li>RT alarm</li> <li>RT fault</li> <li>Monitored outputs</li> <li>Alarm</li> <li>Fault</li> <li>Horn</li> <li>Freely programmable</li> </ul>	1 1 1 1	1 1 1 1	1 1 1 1	1 1 1 2	- - - - -
each with one red, green and yellow LED  Display groups optional, each with one red, green and yellow LED  Up to 96 <sup>3</sup> /-  up to 96 <sup>3</sup> /-  up to 96 <sup>3</sup> /-  up to 96/up to 96  up to 96 <sup>3</sup> )  Plug-in position for RS232, RS485 serial ports  1  2  2  2  2  2  Ethernet connection RJ45  1  1  1  1  1  1  1  1  1  Approvals  - CPR - CPR - VdS  - 0786-CPR-20721 - G209076  G209076  G209076  G209076  G209077  G209078	Operating unit	integrated	integrated	integrated	integrated	integrated
and yellow LED  Plug-in position for RS232, RS485 serial ports  1 2 2 2 2 2 2 Ethernet connection RJ45  1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 Approvals  - CPR - VdS -  0786-CPR-20721 G209076  0786-CPR-20721 G209076  0786-CPR-20721 G209076  0786-CPR-20721 G209076  0786-CPR-20721 G209076	each with one red, green	-/up to 24	-/up to 24	-/up to 48	-/up to 48	-
RS232, RS485 serial ports  Ethernet connection RJ45  1  1  1  1  1  1  1  1  1  Dimensions (WxHxD)  430x398x80 mm  430x398x160 mm  430x796x160 mm  430x796x160 mm  430x796x160 mm  430x398x80 mm  Approvals  - CPR - O786-CPR-20721 - VdS - G209076  G209076  G209077  G209078	each with one red, green	up to 96 <sup>3)</sup> /–	up to 96 <sup>3)</sup> /–	up to 96/up to 96	up to 96/up to 96	up to 96 <sup>3)</sup>
Dimensions (WxHxD) 430x398x80 mm 430x398x160 mm 430x796x160 mm 430x796x160 mm 430x398x80 mm  Approvals  - CPR 0786-CPR-20767 0786-CPR-20721 0786-CPR-20721 0786-CPR-20722 - G209076 G209077 G209078		1	2	2	2	2
Approvals  - CPR	Ethernet connection RJ45	1	1	1	1	1
- CPR     0786-CPR-20767     0786-CPR-20721     0786-CPR-20721     0786-CPR-20722     -       - VdS     -     G209076     G209076     G209077     G209078	Dimensions (WxHxD)	430x398x80 mm	430x398x160 mm	430x796x160 mm	430x796x160 mm	430x398x80 mm
	– CPR – VdS	-	G209076	G209076	G209077	

1) with additional housing and power supply, 3) with extra housing

### **Topology 3**

via backbone and cluster

over entire system necessary

wide redundancy

with each other

protected

- Very large networks spanning long distances

- Highest system availability thanks to system-


– Panels on different clusters can communicate

- Only one remote transmission to fire brigade

- Distributed building complexes can be ideally

- Backbone is realized with fiber-optic cable

Up to 64 panels in one EN 54-conform system with different combinations of clusters and backbone – and with connection to a danger management system via a customer network.

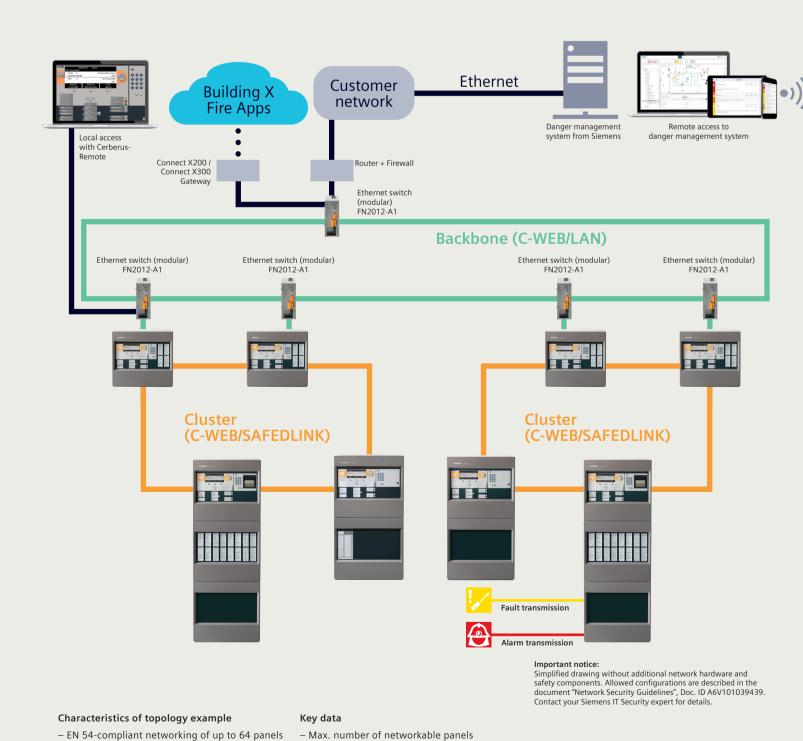

incl. clusters (EN 54-conform):

- Max. number of networkable panels

Number of panels with system-wide view:

– Max. number of clusters:

### Panel overview modular

FC723-ZA FC726-ZA

# Single-sector extinguishing panel Combined fire and ext. control panel

FC722-ZA or FC724-ZA

See FC722-ZA, FC724-ZA

max. 80  $\Omega$ , both conductors

If collective inputs not used: 10 max. 64 (parallel, normally opened)

primary 1, secondary max. 5

25 mA typical @DC 24 V

4 digits 5x7 dot matrix

A6V11480005

primary max. 10 m, secondary max. 1200 m

nitored collective inputs max. 4 (e.g. Manual release and Emergency hold

max. DC 25.8 V max. 2 A

max. 8, collective

-monitored driver outputs | max. 6 Circuit Open drain, Short-circuit-proof


valve, standard, and inverse outputs, max. 10

ground fault, leakage current, open line

				Ī_
	Housing Comfort	Housing Large	Consisting of:	56722.74
Mains voltage	– AC 98127 V – AC 196253 V	– AC 98127 V – AC 196253 V	<ul><li>Fire control panel</li><li>Extinguishing control kit</li><li>Extinguishing terminal</li></ul>	FC722-ZA 6 XCA2005-A XCM7202-Z
Power supply	150 W	150 W	Optional: - Extinguishing terminal	XT2001-A1
Operating voltage	DC 2128.4 V	DC 2128.4 V	Techn. data FC72x	See FC722
Operating current	max. 5 A	max. 5 A	Technical data extinguishin	g card
Battery capacity	2x 12 V, 26 Ah	2x 12 V, 45 Ah	Monitored outputs	valve, stan
Emergency power supply	up to 72 h	up to 72 h	<ul><li>Output voltage</li><li>Output current</li></ul>	max. DC 25 max. 2 A
Connectable detector series	Cerberus PRO FD720 (C-NET)	Cerberus PRO FD720 (C-NET)	<ul><li>Line resistance</li><li>Monitored for</li></ul>	max. 80 Ω, ground faul
Number of lines  – C-NET integrated  (with loop extension)  – Stub lines	2 (4) 4 (8)	4 (8) 8 (16)	Monitored collective inputs  - Number of devices per input	max. 4 (e.g call points)
<ul><li>C-NET ext. (4 per line card)</li></ul>	max. 8	max. 20	Monitored inputs	max. 6 (e.g
Number of addresses	max. 756	max. 1,512	– Number of devices	max. 64 (p
Networkable	<b>√</b>	<b>√</b>	per input	
Integrated inputs/outputs  – Relay outputs			Non-monitored driver outputs  – Current limiting	max. 6 Circ
RT alarm     RT fault	1	1 1	Technical data extinguishin	g terminal
<ul><li>Monitored outputs</li><li>Alarm</li><li>Fault</li></ul>	1 1	1 1	Number of participants per sector	primary 1,
• Horn	1	2	Cable length	primary m
<ul> <li>Freely programmable inputs/outputs</li> </ul>	8	12 (72)1)	Supply input	DC 2130
Operating unit	integrated	integrated	Operating current per terminal	25 mA typ
Display groups integrated, each with one red, green	_	_	Indication LEDs	34 LEDs
and yellow LED			Indication Display	4 digits 5x
Display groups optional, each with one red, green and yellow LED	up to 96	up to 96	Data sheet	A6V11480
Plug-in position for RS232, RS485 serial ports	2	2		
Ethernet connection RJ45	1	1		
Dimensions (WxHxD)	430x796x160 mm	430x796x260 mm		
Approvals – CPD – VdS – LPCB	0786-CPD-21328 G214021 126bn	0786-CPD-20983 G210084 126bn		

1) with additional input/output cards FCI2008-A1

## **Building X Apps offering**

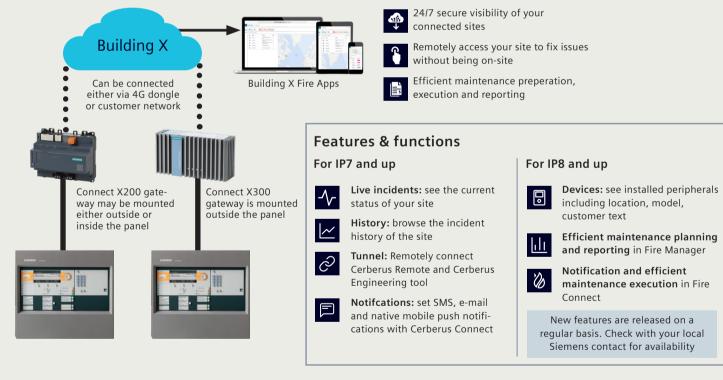


### **Integrated Extinguishing control planning**

#### Single-sector extinguishing

Control pipe

Combined fire detection and extinguishing control panel FC720 operating as a single-sector extinguishing system. FC720 works with most types of extinguishing systems for room or object protection. A single-sector installation consists of a single flooding zone and cylinder bank. In case of a fire, the extinguishing agent flows through the manifolds to the flooding zone and is distributed there by the nozzles. The system can be optionally configured with a reserve

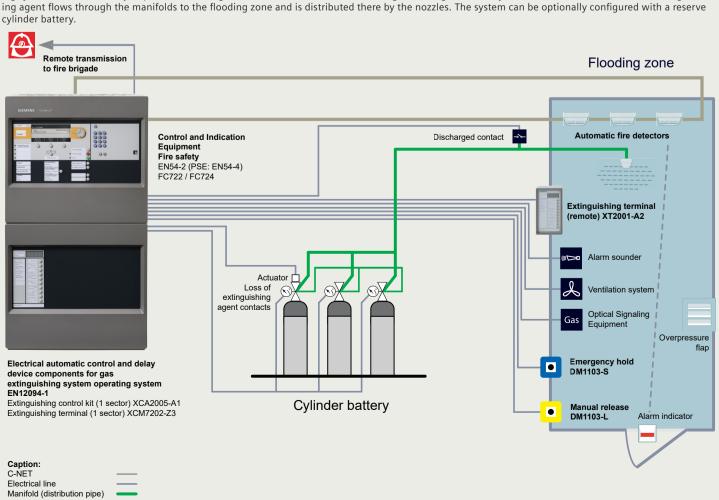

Backbone

be ideally represented

Ethernet switches

wide control

(C-WEB/LAN)

Clusters can be networked via an Ethernet back-

the first manufacturer offering this as a EN 54-

Characteristics of networking via backbone

- Ethernet switch to connect a cluster to the

Redundant connection possible due to two

- Increased EMC protection thanks to fiber-optic

– Easily programmable, EN 54-compliant system-

(for further information on FC726, please see

- Max. number of panels in EN 54 system:

- Number of panels with system-wide view:

– Max. number of panels in a cluster:

Max. distance between clusters

– Fiber optic multi mode:

Fiber optic single mode:

Cluster

Wiring with two wires

second network module

Key data

copper cable

• Without repeater

• With repeater:

fiber-optic cable

Multi mode:

Single mode:

C-NET

system-wide view:

Max. number of networkable clusters:

\* and more with relevant system topology

512 fire detectors to the backbone.

The following guidelines must be observed

(C-WEB/SAFEDLINK)

Via the powerful cluster, up to 32 panels can be

- Increased safety due to degrade mode using a

No additional cabling necessary for degrade

Configurable view of individual panels

- Max. number of networkable panels:

if connected to a danger management

- Max. number of networkable panels

Max. distance between panels with

Max. distance between panels with

Use of all cable types (shielded or unshielded)

- Power supply to all bus elements via the C-NET

- Cable lengths up to 3.3 km with up to 252 bus

modifications to cable network

Up to 252 bus elements on one loop

No shielding necessary

- 2-wire loop

Key data

- Up to 40 T-taps

- Max. number of panels with

- Configurable view of each panel

separate documentation)

All panels can be used as a router panel

#### **SIEMENS**

Loop extension (C-NET, P) FCI2025-A1

RS232 module (isolated) FCA2001-A1

RS485 module (isolated) FCA2002-A1

This is needed, for example, for operating the

Fire department display panel with integrated

The RS485 module (isolated) is plugged into the

The sounder module has connections for 4 conven-

tional sounder lines (primary lines; 4x up to 1 A,

max. 2 A total). The sounder module is screwed

Operating add-on (2x LED-ind.) FCM7213-Y3

This contains 48 display groups each with one

Operating add-on (4x LED-ind.) FCM7214-Y3

This contains 96 display groups each with one

red, green and one yellow LED. Any events can be

Kaba lock cylinder with installation accessories and

Extinguishing key switch Kaba XTO2002-C1

Key set with mounting accessories. Optimally

Extinguishing key switch (Nordic) XTO2003-B1

The event printer FTO2001-A1 is installed directly in

the control panel or in the terminal. It is a thermal

printer which logs all events. An RS232 module

event printer. This is not contained in the printer

Monitored external event printer for serial con-

nection or via Ethernet. Optional: RS232 module

set and must be ordered separately.

(isolated) FCA2001-A1 is required for operating the

keys (Kaba 8 #100). Usable optionally for enabling

Optional: event printer FTO2001-A1

Order no.: S54400-B149-A1

Order no.: S54400-B150 -A1

Key switch Kaba FTO2005-C1

red, green and one yellow LED. Any events can be

fire department operating panel (FAT and FBF)

with 63 addresses each).

set for the event printer.

Order no.: A5Q00005327

[DE and CZ]

PMI mainboard.

– EVAC module [NL]

Order no.: A5Q00009923

Sounder module FCA2005-A1

to the assembly plate FHA2007-A1.

Order no.: A5Q00014866

allocated to the LEDs.

allocated to the LEDs.

Order no.: A5000010113

Order no.: S54392-B12-A1

Order no.: A5000010129

Order no.: S54392-B11-A1

Event printer FTO2001-A1

Order no.: A5Q00010126

Event printer DL3750+

(isolated) FCA2001-A1.

Extinguishing equipment

Order no.: A5Q00023962

Key switch Nordic FTO2006-B1

applicable for operation clearance.

Operating add-ons

Order no.: \$54400-A185-A1

The loop extension makes it possible to double the

from 4 loops to 8 loops) while retaining a constant

number of loops (e.g. from 2 loops to 4 loops or

total number of addresses on the C-NET line card

(e.g. 2 loops with 126 addresses each or 4 loops

This module is needed, for example, for operating

an event printer. It is plugged into the PMI main-

board. The RS232 module is not contained in the

**Expansion options** 

## Cerberus PRO Planning Tool Panels, network and accessories

available in the planning document, Doc. ID A6V10210362.

**Network components** Cluster Backbone To enable remote operation with Cerberus-Remote Ethernet switch (modular) the PC has to be connected to an Ethernet switch of the backbone. Access to a certain panel in a cluster Ethernet Order no.: \$54400-B152-A1 will be granted by installing an S1 license key into Customer Connect X300 Gateway CXG3.X300 network Network module (SAFEDLINK) Connect X300 gateway is connecting to a wide FN2001-A1 range of both Siemens and third-party building With this module, the station can be networked via the cluster. For this purpose in Thanks to this gateway, the Fire Safety Systems Danger management Ethernet module is necessary to install a network module. (electric/CAT5) VN2001-A1 can be connected to the cloud, and therefore be system from Siemens danger management system In case of additional requirements in Order no.: \$54400-A42-A1 upgraded with various digital use-cases. Router + Firewall terms of the degrade mode function, Order no.: S55842-Z121-A100 2 network modules can be installed. Remote access with Cerberus-Remote For example for: Networked panels with more than nplified drawing without additional network hardware and safety components. Connect X200/ Ethernet module (MM) VN2002-A1 Ethernet switch 512 C-NET devices Connect X300 (modular) er no.: S54400-A43-A1 Networked panels with connection to Doc. ID A6V101039439. Contact your Siemens IT Security expert for details. FN2012-A1 Gateway remote transmission and with more than 512 C-NET devices Order no.: A5Q00012851 Fire control panel FC722-YZ Fire control panel FC724-ZA Fire control panel FC724-ZE Fire control panel FC722-ZZ Connect X200 Gateway CXG3.X200 Connect X200 is a cost-effective gateway, conconsisting of: consisting of: consisting of: consisting of: thernet module (SM) VN2003-A1 necting to a wide range of both Siemens and third-Control unit Control unit Control unit Control unit Order no.: S54400-A44-A1 party building products. It has the possibility to be - 48 display groups each with one - 24 display groups each with bone, using industrial LAN technology. Siemens is mounted inside the panel. • Event printer FTO2001-A1 red, green and one yellow LED Event printer FTO2001-A1 one red, green and one yellow LED Thanks to this gateway, the Fire Safety Systems • Kev switch Kaba FTO2005-C1 Kev switch Kaba FTO2005-C1 – Optional: kev switch Kaba can be connected to the cloud, and therefore be approved solution. With standard IT architecture. • Operating add-on, 48 display groups Event printer FTO2001-A1 FTO2005-C1 Optical fiber networking modules building structures and organizational processes can upgraded with various digital use-cases. each with one red, green and one Key switch Kaba FTO2005-C1 nnection module (MoNet) - Standard: 430x398x160 mm (Wx FN2006-A1 (SM) and FN2007-A1 (MM) Order no.: S55842-Z131-A100 vellow LED FCM7213-Y3 • Operating add-on, 96 display groups - Standard: 430x398x160 mm (WxHxD) - 70 W power supply With these optical fiber networking mod • Operating add-on, 96 display groups each with one red, green and one Order no.: \$54400-A153-A1 Accessory kit + ACDC (X200) FCA2056-A1 – Max. battery capacity: 2x 12 Ah - 70 W power supply ules, Cerberus PRO stations can be linked each with one red, green and one vellow LED FCM7214-Y3 – Max. battery capacity: 2x 12 Ah Order no.: S54400-S115-A1 Order no.: S54433-C113-A1 to the C-WEB/SAFEDLINK system bus over vellow LED FCM7214-Y3 Order no.: \$54433-C113-A2 great distances by glass fiber cable. The System-wide view Mounting plate (X200) FHA2063-A1 - Redundant transmission thanks to circular wiring Comfort: 430x796x160 mm (WxHxD) redundant feed allows EN 54-compliant with the fire terminal - 150 W power supply Order no.: S54400-B116-A1 - Comfort: 430x796x160 mm (WxHxD) networking even if the networking mod-- Max. battery capacity: 2x 26 Ah – 150 W power supply Without S1 (FCA2033-A1) S2 (FCA2034-A1) S3 (FCA2035-A1) S4 (FCA2036-A1) - Max. battery capacity: 2x 26 Ah Order no.: \$54433-C115-A2 **Backbone** Order no.: S54433-C115-A1 Two independent, galvanically (C-WEB/LAN) separated channels - SC connections for optical cables Two redundant, monitored power Cerberus-Remote and feeds EN 54-approved thernet switch (modular) BACnet 3rd-party provider - Installation in the station or remote FN2012-A1 - Can be installed upright or horizontally In the basic version each FC724 FN2006-A1: single-mode transmission up to 40 km Number of panels placed directly on backbone: 4\* Order no.: \$54400-A109-A1 - FN2007-A1: multi-mode transmission up to 4 km Order no.: S54400-A110-A1 - To fulfill the EN 54 norm, only 1 Ethernet switch is required to connect control panels with less than Fire control panel Fire control panel modular FC721 (1-loop) Fire control panel FC722 (2-loop) Fire control panel FC724 (4-loop) FC726 / FC723 Description Description FC726 (modular) Description FC723 (modular) Description Fire control panel Description Technical data Fire control panel FC724-ZAG FC722-ZZG The FC721 is a compact fire control panel. FC726 is a modular fire control panel. FC723 is a modular fire control panel. The FC722 is a compact 2-loop fire control The FC724 is a compact 4-loop fire C-NET detector lines It has the following features: It has the following features: - Number of addresses: max. 504 – 1 C-NET loop It has the following features: - 4 C-NET loops with 1.5 A line driver - 2 C-NET loops with 1.5 A line driver panel. It has the following features: - Number of loops/stubs: 4/8 Control unit Control unit 5 slots for additional module bus cards 2 slots for additional module bus cards 4 C-NET loops with 1.5 A line driver
 Optionally with loop extension: 2 C-NET loops with 1.5 A line driver Integrated control unit Integrated inputs/outputs for peripherals Integrated inputs/outputs for periphe 8 loops/16 stubs – Event printer FTO2001-A1 Event printer FTO2001-A1 consisting of: Integrated power supply Integrated control unit Integrated control unit Integrated control unit networked (fire control panels and fire terminals). Key switch Kaba FTO2005-C1 Key switch Kaba FTO2005-C1 Inputs and outputs Automatic configuration Control unit - Integrated power supply Integrated power supply Integrated control unit Integrated power supply 1 relay output for RT alarm - Operating add-on, 48 display each Characteristics of networking via the system bus Cloud connectivity Optional: key switch Kaba - Automatic configuratior Integrated power supply Automatic configuration Automatic configuration - 1 relay output for RT fault with one red, green and yellow LED Technical data X200 Gateway FTO2005-C1 Networkability via backbone (C-WEB/LAN),
 Networkability via backbone (C-WEB/LAN), Automatic configuration Networkability via backbone (C-WEB/LAN), 1 monitored alarm output Redundant transmission thanks to circular wiring Networkability via backbone (C-WEB/ \_ 1 monitored fault output cluster (C-WEB/SAFEDLINK) or Ethernet cluster (C-WEB/SAFEDLINK) or Ethernet cluster (C-WEB/SAFEDLINK) or Ethernet **C-NET detector lines** - Operating add-on, 96 display each LAN), cluster (C-WEB/SAFEDLINK) or — 2 monitored sounder outputs - Fco: 430x398x80 mm (WxHxD) – Number of addresses: max. 126 with one red, green and yellow LED 150 W power supply Technical data **Technical data**  70 W power supply Technical data Number of integrated loops/stubs: 1/2 Max. battery capacity: 2x 12 Ah – Max. battery capacity: 2x 7 Ah – 12 configurable inputs/outputs DC 24 V Cloud connectivity mode; even for systems with more than 512 fire Inputs and outputs **Basic configuration Basic configuration** C-NET detector lines Order no.: S54400-C37-A1 Order no.: \$54400-C32-A2 1 Ethernet connection (RJ45) 1 relay output for RT alarm - Number of loops/stubs: 2/4 - X200 Gateway Number of loops/stubs: 4/8 Number of addresses: max. 252 Optional: sounder module for 1 relay output for RT fault Optionally with loop extension Optionally with loop extension: Number of loops/stubs: 2/4 splitting the sounder line output 1 monitored alarm output - Comfort: 430x796x160 mm (WxHxD) 8 loops/16 stubs – Optionally with loop extension: into 4 monitored outputs (2 A) 1 monitored fault output 150 W power supply 4 loops/8 stubs Modular extension Modular extension 1 monitored sounder output (1 A) Line card for 252 C-NET devices Line card for 252 C-NET devices Max. battery capacity: 2x 26 Ah Inputs and outputs – 4 configurable inputs/outputs DC 24 V - 1 relay output for RT alarm Line card for 512 SynoLOOP devices Line card for 512 SynoLOOP devices Order no.: \$54400-C38-A1 1 Ethernet connection (RJ45) I/O card with inputs/outputs (12) I/O cards with inputs/outputs (12) 1 relay output for RT fault 1 monitored alarm output Final configuration Final configuration 1 monitored fault output – Number of addresses: max. 1,512 - Number of addresses: max. 756 - 1 monitored sounder output (1 A) Fire terminal FT724 - Number of loops/stubs: 12/24 - Number of loops/stubs: 28/56 Fire control 2 km - 8 configurable inputs/outputs DC 24 V Fire control panel FC721-YZ – 1 Ethernet connection (RJ45) consisting of: panel with Description **Technical data** Cluster Optional: sounder module for splitting the Control unit sounder line output into 4 monitored The FT724 has the following features: – DC 24 V system power supply 40 km extinguishing (C-WEB/SAFEDLINK) 24 display groups each with one outputs (2 A) Integrated control unit Alarm current: 130 mA red, green and one yellow LED - Separate DC 24 V supply input possible Optional: key switch Kaba control Redundant DC 24 V supply input FTO2005-C1 Networkability via C-WEB/SAFEDLINK Housing or Ethernet - Eco: 430x398x80 mm (WxHxD) – 70 W power supply Max. battery capacity: 2x 7 Ah The C-NET is a modern, multi-purpose bus system. Order no.: S54400-C32-A3 It allows rapid, fail-safe communication between To the second se the Cerberus™ PRO bus elements and the fire control Characteristics of networking via the detector bus **ASD from Siemens** Fire terminal FT724-ZZ - Integration of star-shaped cable networks without The FDA241 is a very early consisting of: warning dual wavelength (blue Control unit Fire control panel FC726-ZA Fire control panel FC723-ZA Fire control panel FC722/724-ZA Fire control panel FC722-ZA Fire control panel FC722-ZE and infrared) smoke detector designed to protect small with extinguishing control consisting of: consisting of: consisting of: consisting of: Event printer FTO2001-A1 business-critical environments (except transponder FDCIO223, FDCI723, LaserFOCUS, Control unit Control unit Control unit • Key switch Kaba FTO2005-C1 Control unit up to 800 m<sup>2</sup>. extinguishing control unit XC10 and ASD FDA221, - Optional: Fire control panel - 48 display groups each with Order no.: S5433-F14-A1 • Event printer FTO2001-A1 Event printer FTO2001-A1 - 2-loop panel FC722-ZA • Event printer FTO2001-A1 one red, green and one yellow LED - Eco: 430x398x80 mm (WxHxD) • Key switch Kaba FTO2005-C1 • Key switch Kaba FTO2005-C1 Key switch Kaba FTO2005-C1 Order no.: \$54433-C113-A3 Operating add-on, 48 display Operating add-on, 48 display • Operating add-on, 48 display groups • Event printer FTO2001-A1 4-loop panel FC724-ZA 70 W power supply groups each with one red and one groups each with one red and one each with one red, green and one • Key switch Kaba FTO2005-C1 Order no.: S54433-C115-A1 Max. battery capacity: 2x 7 Ah Floor repeater terminal FT2010-A1 yellow LED FCM7211-Y3 yellow LED FCM7211-Y3 vellow LED FCM7213-Y3 Fire Brown Sept 5 State Operating add-on, 96 display groups Housing (Eco) FH7201-Z3 and Extinguishing terminal (1 sector) Operating add-on, 96 display Operating add-on, 96 display Operating add-on, 96 display groups each with one red, green and one Used for the display and control of operating add-on (2x LED-ind.) extinguishing terminal XCM7202-Z3 groups each with one red and one groups each with one red and one each with one red, green and one yellow LED FCM7214-Y3 messages from the monitored area FCM2713-Y3 (remote) Order no.: \$54392-B18-A1 yellow LED FCM7212-Y3 yellow LED FCM7212-Y3 vellow LED FCM7214-Y3 XT2001-A2 Order no.: \$54400-C31-A2 Extinguishing control kit (1 sector) - Comfort: 430x796x160 mm – Max. 8 FT2010/FT2011 per FC721/FC722 Order no.: S54392-F2-A1 XCA2005-A1 FP120-Z1 - Comfort: 430x796x160 mm (WxHxD) Large: 430x796x260 mm (WxHxD) - Comfort: 430x796x160 mm (WxHxD) – Max. 16 FT2010/FT2011 per FC724 consisting of: Power supply kit A (70 W) – Max. 50 FT2010/FT2011 per FC726 – 150 W power supply - Extinguishing card XCI2005-A1 - Max. battery capacity: 2x 45 Ah The standalone power supply Max. battery capacity: 2x 26 Ah Max. battery capacity: 2x 26 Ah Max. battery capacity: 2x 26 Ah Order no.: A5Q00014104 Card cage (1 sector exting.) converts the mains voltage to Order no.: S54433-C116-A1 Order no.: S54433-C114-A1 Order no.: S54433-C113-A3 Order no.: \$54433-C113-A4 FCA2046-A1 system voltage and charges Accessory kit FCA2047-A1 the batteries. Card cage connection FCA2006 Order no.: S54400-S122-A1 Order no.: \$54392-\$20-A1 Legend for the interfaces and networks: Detailed planning information C-NET Detailed information for planning of the system are

(For further details see also the

Cerberus PRO Planning Tool –


C-NET devices)

Manual call point, red ASA neural fire detector

OOH740

#### Housings

#### Max. battery capacity: 2x 7 Ah Power supply kit (70 W) FP2015-A1



Housing (Eco) FH7201-Z3



#### Housing (Standard) FH7202-Z3 – Max. battery capacity: 2x 26 Ah

Order no.: \$54400-B72-A1

– 430x398x160 mm (WxHxD) • Power supply kit (70 W) FP2015-A1 or • Power supply kit (150 W) FP2004-A1 or

Power supply kit (150 W) FP2004-A1 or

• Event printer FTO2001-A1

Order no.: \$54400-B71-A1

Housing (Large) FH7205-Z3

Max. battery capacity: 2x 65 Ah

• Power supply kit (70 W) FP2015-A1

• Power supply kit (150 W) FP2004-A1

• Power supply kit (150 W) FP2005-A1

Housing (Large Extension) FH7204-Z3

Power supply kit (70 W) FP2015-A1

• Power supply kit (150 W) FP2004-A1

Power supply kit (150 W) FP2005-A1

Flush mounting bezel one HU FHA2017-A1

Flush mounting bezel two HU FHA2015-A1

• Operating add-on (2x LED-ind.) FCM7213-Y3

• Operating add-on (4x LED-ind.) FCM7214-Y3

– Max. battery capacity: 2x 65 Ah

• Operating add-on (2x LED-ind.) FCM7213-Y3

• Operating add-on (4x LED-ind.) FCM7214-Y3

430x796x260 mm (WxHxD)

• Event printer FTO2001-A1

Order no.: \$54400-B86-A1

- 430x398x260 (WxHxD)

• Event printer FTO2001-A1

Optional bezel for flush mounting

Optional bezel for flush mounting

installation for all fire control panels

installation for all fire control panels

Order no.: S54400-B89-A1

and FT724 fire terminal:

and FT724 fire terminal;

Order no.: A5Q00024621

530x886 mm (WxH)

530x500 mm (WxH)

additional power supply (150 W) FP2005-A1

• Operating add-on (2x LED-ind.) FCM7213-Y3

• Operating add-on (4x LED-ind.) FCM7214-Y3

additional power supply (150 W) FP2005-A1 • Event printer FTO2001-A1 • Operating add-on (2x LED-ind.) FCM7213-Y3 • Operating add-on (4x LED-ind.) FCM7214-Y3 Order no.: S54400-B70-A1

Housing (Comfort) FH7203-Z3 Max. battery capacity: 2x 26 Ah 430x796x160 mm (WxHxD) • Power supply kit (70 W) FP2015-A1 or

### Module bus cards for FC723 / FC726

Line card (FDnet/C-NET, P) FCL2008-A1



For 252 C-NET devices on 4 loops or 8 stubs. Order no.: S54400-A182-A1

Line card (SynoLOOP) FCL7201-Z3

For 128 devices per loop or 4 stubs.

Order no.: S54400-H116-A1



I/O card (RT) FCI2007-A1 For alarm and fault transmission. Order no.: S54400-A20-A1

I/O card (programmable) FCI2008-A1 12 programmable inputs/outputs with defined behavior in degrade mode. Order no.: \$54400-A6-A1

I/O card (horn/monitored) FCI2009-A1 8 monitored horn lines or monitored outputs. Order no.: \$54400-A21-A1



Power supply kit A (70 W) FP120-Z1 The standalone power supply converts the mains voltage to system voltage and charges the batteries.



Order no.: A5Q00020825

Power supply kit (150 W) FP2005-A1 Power supply can be connected in the housing directly after FP2004-A1.

Power supply kit (150 W) FP2004-A1

Power supply for installation in empty housings Optional: additional power supply with FP2005-A1




### Serial interfaces


Backbone (C-WEB/LAN) C-NET C-NET-Ex

Cluster (C-WEB/SAFEDLINK) Network for connecting panels Network for connecting Cerberus PRO addressable Ex devices

One optional RS232 and/or one RS485 interface (also freely combinable) per panel or fire terminal Network for connecting clusters Network for connecting Cerberus PRO addressable devices












Mounting kit (marine) FHA2035-A1
















#### Extinguishing control kit (1 sector) XCA2005-A1 - Extinguishing card XCI2005-A1



- Card cage (1 sector exting.) FCA2046-A1 Accessory kit FCA2047-A1 Card cage connection FCA2006 Order no.: \$54392-\$20-A1





Extinguishing key switch Kaba XTO2002-C1 Order no.: S54392-B12-A1




Extinguishing key switch (Nordic) XTO2003-B1 Order no.: S54392-B11-A1





Order no.: \$54400-\$122-A1



Power supply (70 W) FP2015-A1 For the independent power supply of fire



Order no.: A5Q00018779